DOUBLE POLE DESIGNER SWITCH

Wiring for two motors to a double pole designer switch

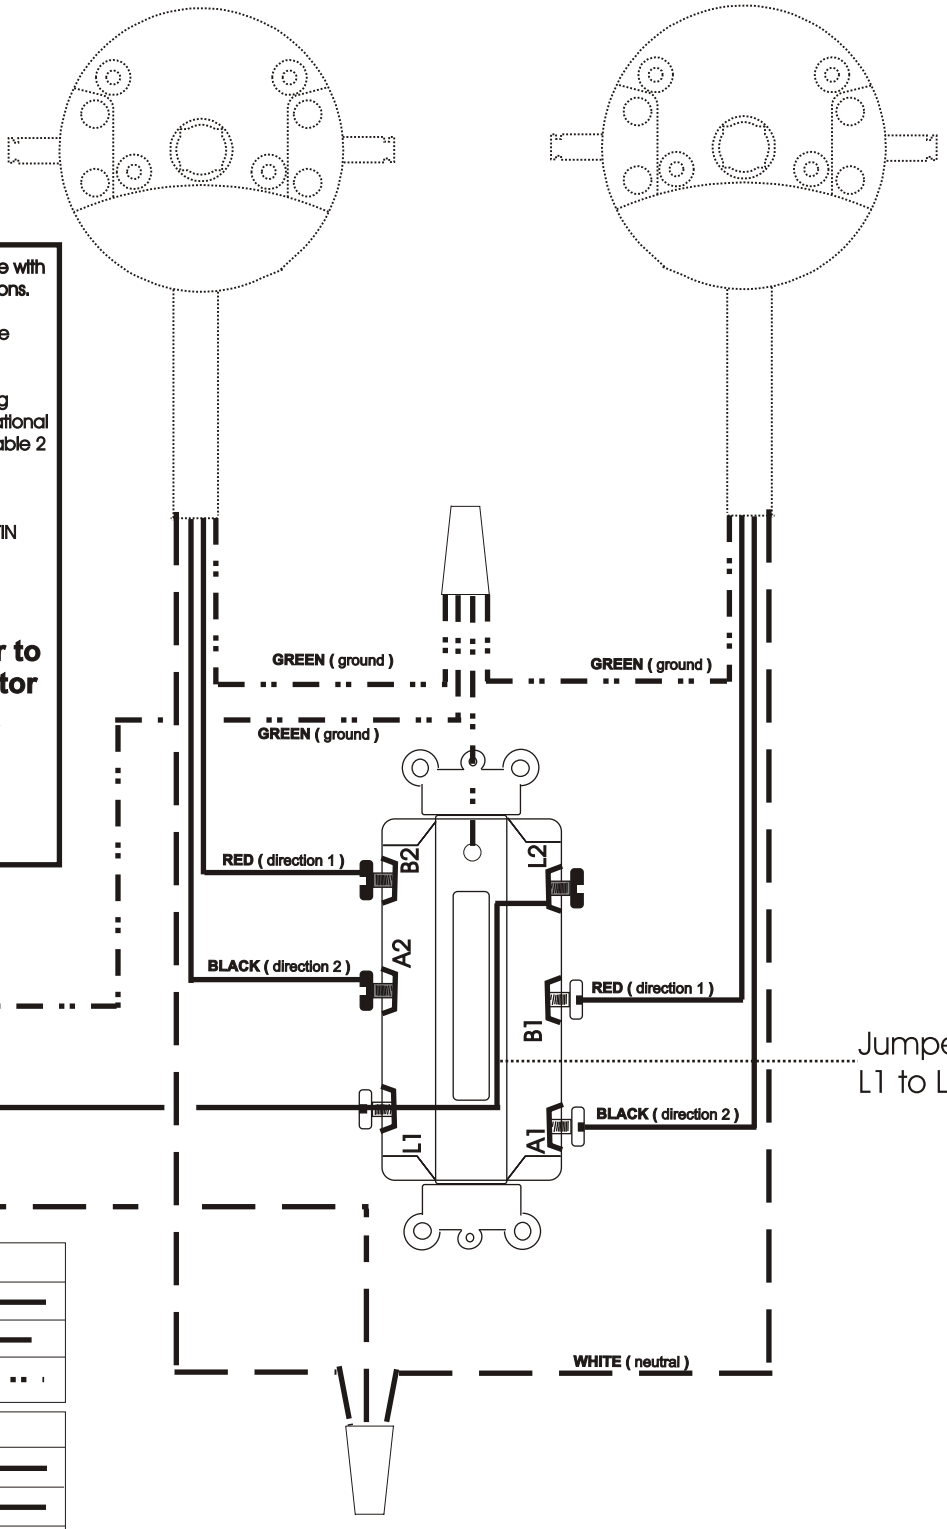

NOTICE: For installation by a qualified electrician in accordance with national and local electrical codes, and the following instructions.

CAUTION: RISK OF ELECTRICAL SHOCK. Disconnect power before installing. Never wire energized electrical components.

Select conductors having 90°C or higher rated insulation having sufficient ampacity in accordance with the 60°C column of National Electrical Code® Table 310-16 or Canadian Electrical Code Table 2

Terminal capacity: #14 AWG to #10 AWG

Strip conductors using strip gage on switch body. DO NOT USE TIN CONDUCTORS.

Warning

DO NOT wire more than one operator to a single pole switch. A second operator can be wired to the second pole of a double pole switch.

DO NOT connect two switches to an operator without a relay.

Power in		
Hot	Black	———
Neutral	White	— — —
Ground	Green	— ·· — ·· — ··

Motor Leads		
Direction 1	Red	———
Direction 2	Black	———
Neutral	White	— — —
Ground	Green	— ·· — ·· — ··