




115 V - 60 Hz

NEUTRAL

HOT

GROUND

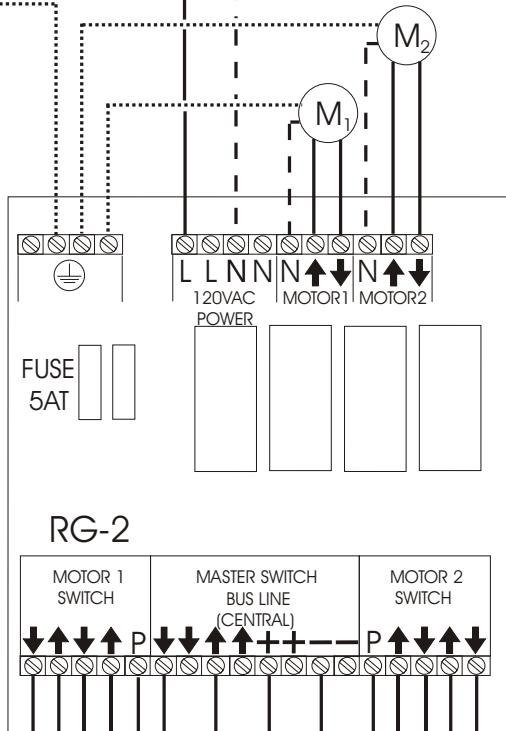

Individual switches can be linked to form a subgroup

Individual switches can be linked to form a subgroup

Individual Control Motor 1 ( AV or Switch )

Individual Control Motor 2 ( AV or Switch )

Master Control ( AV or switch )

Master Switch Bus Line ( 4 wires )  
 + Positive 24 VDC (switching power)  
 - Negative 24 VDC  
 ▲ Up  
 ▼ Down

## 2 RG.2


- \* Two RG2 Relays
- \* Four Motors
- \* Low-Voltage Momentary Master Switch
- \* Four Low-Voltage Momentary Individual Control Switches

115 V - 60 Hz

NEUTRAL

HOT

GROUND

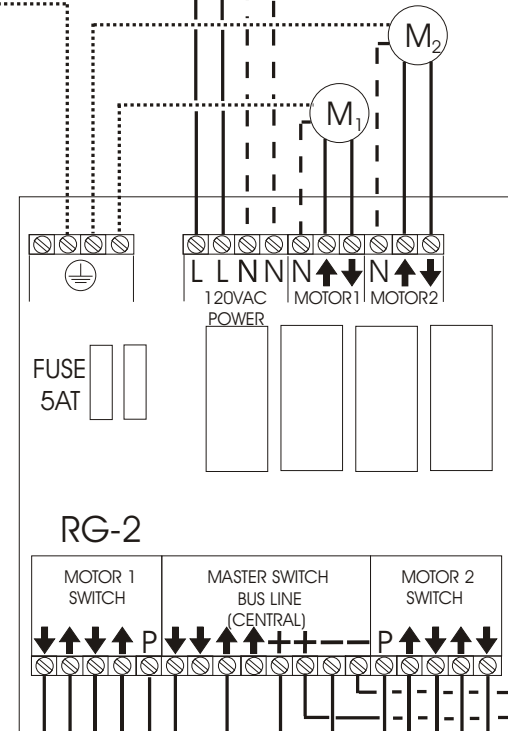

Individual switches can be linked to form a subgroup

Individual switches can be linked to form a subgroup

Individual Control Motor 1 ( AV or Switch )

Individual Control Motor 2 ( AV or Switch )

To Other RG-2's In Group

